

OPTIMIZATION-BASED MONITORING-SUPPORTED CALIBRATION OF A THERMAL PERFORMANCE SIMULATION MODEL

M. Taheri^{*†} and A. Mahdavi

*Department of Building Physics and Building Ecology, Vienna University of Technology,
Vienna, Austria*

ABSTRACT

Building performance simulation is being increasingly deployed beyond the building design phase to support efficient building operation. Specifically, the predictive feature of the simulation-assisted building systems control strategy provides distinct advantages in view of building systems with high latency and inertia. Such advantages can be exploited only if model predictions can be relied upon. Hence, it is important to calibrate simulation models based on monitored data. In the present paper, we report on the use of optimization-aided model calibration in the context of an existing university building. Thereby, our main objective is to deploy data obtained via the monitoring system to both populate the initial simulation model and to maintain its fidelity through an ongoing optimization-based calibration process. The results suggest that the calibration can significantly improve the predictive performance of the thermal simulation model.

Received: 4 March 2014; Accepted: 3 July 2014

KEY WORDS: thermal performance, building monitoring, simulation, calibration, optimization.

1. INTRODUCTION

1.1 Thermal performance simulations

Building performance simulation tools are conventionally used to predict the future performance of building designs. More recently, however, the potential for the deployment of simulation in the buildings' operation phase is being increasingly explored. To conduct

^{*}Corresponding author: Department of Building Physics and Building Ecology, Vienna University of Technology, Vienna, Austria

[†]E-mail address: mahnameh.taheri@tuwien.ac.at (M. Taheri)

building thermal performance simulation, several parameters are required to be defined, including:

- Building geometry
- Thermal properties of the construction components
- Specification of the ventilation and infiltration rates
- Heating and cooling systems
- Internal loads such as occupants, lightings, etc.
- Weather file and outdoor environment [1].

To support building design decision making via simulation, its reliability and fidelity is critical. However, the act of simulation always involves uncertainty due to required assumptions, simplifications, unknown parameters, and errors. For example, assumptions and simplifications in the modelling of the complex geometries and properties can cause systematic simulation errors. Moreover, the future state of buildings is insufficiently known during the design phase, thus affecting the accuracy of the predictions [2]. Another parameter, essential to be considered in performance simulations, is the "dynamic nature of the building operation" [3] and the associated variations in the relevant parameters affecting the building performance (e.g. seasonal changes in the environmental conditions or occupant's behavior). Therefore, in order to evaluate the reliability of simulation predictions, we need to verify them in different time periods and under different conditions.

1.2 Optimization aided calibration

The quality of any simulation-based decision-making greatly depends on the reliability of the deployed simulation model [4]. Thus, to ensure that predictions are dependable, applied simulation models must be calibrated. The primary method to assure the accuracy and consistency of the predicted performance involves the simulated and the actual monitored parameters (e.g. comparing the measured and simulated indoor temperature or energy use) [5]. The approach is finding an automated method for calibration of the simulation models through an optimization-based process in order to minimize the differences between the actual and predicted building performance [6].

Generally, optimization is the process of finding optimal values for a set of independent parameters, which leads to minimization of an objective function. In a building simulation model, examples of the independent variables are, for instance, the material properties, and building component dimensions [7]. Optimization objectives could be, for example, minimization of the buildings' energy use and operation costs or – in case of simulation calibration – the minimization of the difference between the simulated and actual values of various building performance indicators [8]. Although, the use of building simulations in tandem with model optimization has been growing, formulation of appropriate algorithms for optimizations is still a challenge [9]. Given the dynamic nature of building operation, some input parameters of the model may have to be subjected to calibration on a recurrent basis [3]. This circumstance implies that the calibration task cannot be approached as an ad hoc or one-time activity. Rather, it needs to be conducted on a systematic basis. Consequently, the entire calibration process should be preferably automated to ensure efficiency and consistency [10].

Previous efforts have documented, amongst other things, the use of the GenOpt optimization application in the context of the simulation based building systems control [7,

10, 11 and 12]. GenOpt [13] is an optimization program geared toward the thermal building simulation [8]. It can be referred as an interface between the text-based building simulation programs, for instance EnergyPlus [14] and optimization algorithms [15].

2. METHODOLOGY

2.1 Case study

An existing building in Vienna, Austria, was selected as a case study to evaluate the potential of an optimization-aided thermal simulation model calibration. The monitoring system installed in this building continuously captures indoor environmental parameters. Thus, various streams of data are gathered from three offices within the building, including time-varying parameters such as the state of windows (open/closed), blinds (open/closed), lights (on/off), occupancy (absence/presence), and heat emission of the radiators (Table). Fig. 1 shows the floor plan of the building and the thermal zoning in the simulation model. The Figure includes also the location of the installed sensors.

Table 1: Use of monitored data in the calibration process

| Data use | Data point | Unit |
|----------------------------------|------------------------------|--------------------|
| Creating local weather data file | Global horizontal radiation | W.m^{-2} |
| | Diffuse horizontal radiation | W.m^{-2} |
| | Outdoor air temperature | $^{\circ}\text{C}$ |
| | Outdoor relative humidity | % |
| | Wind Speed | m.s^{-1} |
| | Wind direction | degree |
| | Atmospheric pressure | Pa |
| Creating the initial model | Window contact | - |
| | Electric light | - |
| | Occupancy | - |
| | Blind position | - |
| | Radiators' heat emission | W |
| Calibration | Indoor air temperature | $^{\circ}\text{C}$ |

2.2 The building model

The building simulation engine EnergyPlus 7.0, was used in this study. In order to create the initial model, building geometry and thermal properties of the components were specified. Each monitored room was modeled as a separate thermal zone (zones 2, 3, 4 in Fig. 1). Moreover, for the purpose of a number of calibration scenarios, the adjacent non-monitored zones were also included in the model to control the boundary conditions of the monitored spaces. In addition, we populated the model with the mentioned streams of data provided by

the monitoring system. Incorporating the values of time-varying input parameters into the model was accomplished with the aid of a Matlab script [16]. This program calls different streams of monitored data from building management system database and converts them to compact schedules using EnergyPlus input file syntax. These schedules are later assigned to the corresponding input parameter in the model.

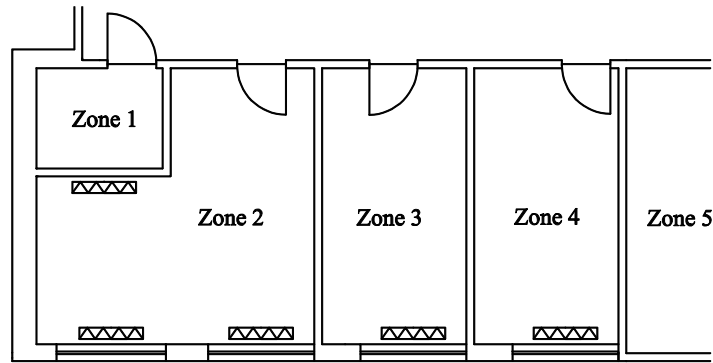


Figure 1: Floor plan and thermal zoning

Table 2: Run periods

| Periods | Start date | End date |
|-------------------------------|------------|------------|
| 1 st summer period | 10.06.2011 | 23.07.2011 |
| 2 nd summer period | 24.07.2011 | 26.08.2011 |
| 1 st winter period | 15.02.2011 | 24.03.2011 |
| 2 nd winter period | 15.02.2012 | 24.03.2012 |

2.3 Run periods

The model calibration and validation process involved a monitoring period of five months including two summer and two winter periods (Table 2).

2.4 Optimization-aided calibration

In an optimization-aided simulation model calibration, the objective function addresses the error in simulated output (in this case zone mean air temperature). In order to minimize the objective function, a number of input parameters of the model are systematically varied within specified ranges. To execute the optimization process, the generic optimization tool GenOpt was selected. This tool supports the efficient inclusion of simulation data from applications such as EnergyPlus in the course of the optimization [9]. The optimization algorithm was the hybrid generalized pattern search with particle swarm algorithm. This is one of the recommended generic algorithms for problems, where the cost function cannot be explicitly stated, but can be approximated numerically by a thermal building simulation program [13].

2.5 Calibration studies

To arrive at a calibrated simulation model of the offices under study, a sequence of simulation and calibration studies was conducted in terms of the following steps:

1. A single zone model (zone 3, Fig. 1) was generated based on available information about the building and the monitored data. The monitored air temperature of the adjacent offices was used as boundary conditions of the zone. This model was simulated for all specified run periods (Table 2). The model evaluation statistics were derived based on the monitored and simulated zone mean air temperature.

2. The single zone model was calibrated for the first run period (1st calibration). In this calibration, eight input parameters of the model were subjected to the optimization-based calibration (Table 3). Subsequently, the calibrated single zone model was evaluated for all run periods.

3. A three-zone model of the building was developed (zones 2, 3 and 4, Fig. 1). This model was fed with the optimized values of the eight input parameters that were calibrated in step 2. The model was simulated and evaluated for entire run periods.

4. The three-zone model was calibrated for the first summer period (2nd calibration) and validated for the second summer period. In this calibration step, only the infiltration and ventilation rates were subjected to optimization.

5. The three-zone model was calibrated for the first winter period (3rd calibration) and validated for the second winter period. Similar to step 4, this calibration had two variables, namely infiltration and ventilation rates.

6. A five-zone model was generated by adding the adjacent unmonitored spaces (zones 1 and 5, Fig. 1). The mean air temperature of these two zones during the 1st summer period was subjected to the 4th calibration. The resulting model was validated for the 2nd summer period.

7. Using the five-zone model, the mean air temperature of the adjacent zones (zones 1 and 5, Fig. 1) during the 1st winter period was subjected to the 5th calibration. The resulting model was validated for the 2nd winter period.

2.6 Calibration variables

As thermal performance simulation models involve numerous input parameters, subjecting all these variables to an optimization-based calibration is computationally expensive. Methods such as sensitivity analysis can be deployed to identify the most influential parameters [16 and 17]. For the purposes of the present study, the calibration variables and their associated variation ranges were selected based on the authors' previous experiences.

For the first calibration, eight input variables were selected (see Table 3), which address the heat transfer processes in the building, namely conduction, convection (air infiltration and ventilation), and solar radiation. For the second and third calibrations, only the infiltration and ventilation rates were subjected to calibration. The next two calibrations only tune the average indoor temperature of the adjacent zones during summer and winter. Table 3 demonstrates the included calibration variables together with their initial values and variation ranges.

Table 3: Initial values (together with lower/upper limits) of the calibrations variables

| Calibration variables | Units | Lower limit | Initial value | Upper limit | Calibration | | | | |
|-----------------------|------------------------------------|-------------|---------------|-------------|-----------------|-----------------|-----------------|-----------------|-----------------|
| | | | | | 1 st | 2 nd | 3 rd | 4 th | 5 th |
| Solar transmittance | | | | | | | | | |
| Green 6mm glass | - | 0.34 | 0.48 | 0.62 | × | | | | |
| Clear 6mm glass | - | 0.54 | 0.78 | 0.85 | × | | | | |
| Thermal conductivity | | | | | | | | | |
| Mineral wool | W.m ⁻¹ .k ⁻¹ | 0.031 | 0.039 | 0.047 | × | | | | |
| XPS | W.m ⁻¹ .k ⁻¹ | 0.03 | 0.05 | 0.07 | × | | | | |
| Density | | | | | | | | | |
| Ceiling concrete | kg.m ⁻³ | 1260 | 1800 | 2340 | × | | | | |
| Wall concrete | kg.m ⁻³ | 980 | 1400 | 1820 | × | | | | |
| Infiltration rate | | | | | | | | | |
| Summer | h ⁻¹ | 0.1 | 0.2 | 0.4 | × | × | | | |
| Winter | h ⁻¹ | 0.1 | 0.2 | 0.4 | | | × | | |
| Ventilation rate | | | | | | | | | |
| Summer | h ⁻¹ | 0.5 | 1.0 | 3.0 | × | × | | | |
| Winter | h ⁻¹ | 0.5 | 1.0 | 3.0 | | | × | | |
| Mean air temperature | | | | | | | | | |
| Zone 1 | Summer | °C | 23.6 | 26.7 | 28.3 | | | | × |
| | Winter | °C | 19.6 | 24.2 | 26.3 | | | | × |
| Zone 5 | Summer | °C | 23.6 | 26.6 | 28.3 | | | × | |
| | Winter | °C | 19.6 | 23.9 | 26.3 | | | | × |

2.7 Cost function

In an optimization-aided calibration, the cost function addresses the difference between the measured and simulated values. In the present study, this was calculated for the zone mean air temperature. To address the error in the cost function two model evaluation statistics were used. The first statistic is the "Coefficient of Variation of the Root Mean Squared Deviations" (Equations 1 & 2). $CV(RMSD)$ aggregates the runtime individual time step errors into a single dimensionless number [10, 18 and 19].

$$RMSD = \sqrt{\frac{\sum_{i=1}^n (m_i - s_i)^2}{n}} \quad (1)$$

$$CV(RMSD) = \frac{RMSD}{m} \cdot 100 \quad (2)$$

The other deployed statistic is the "coefficient of determination" denoted by R^2 . R^2 describes the proportion of the variance in measured data explained by the model [20]. The coefficient of determination ranges from 0 to 1. An R^2 of 1.0 indicates that the regression line perfectly fits the data. Therefore, the R^2 value is to be maximized in the optimization process. Van Liew et al. concluded that the values more than 0.5 can be counted as indicative [21] R^2 was calculated via Equation 3.

$$R^2 = \left(\frac{n \sum m_i s_i - \sum m_i \sum s_i}{\sqrt{(n \sum m_i^2 - (\sum m_i)^2) (n \sum s_i^2 - (\sum s_i)^2)}} \right)^2 \quad (3)$$

In Equations 1 to 3, m_i is the measured air temperature at each time step, s_i is simulated air temperature at each time step, n is the total number of time steps, and \bar{m} is the mean of the measured values. The defined cost function f takes into account the $CV(RMSD)$ and R^2 in an equally weighted manner (Equation 4).

$$f_i = 0.5 \cdot CV(RMSD)_i + 0.5 \cdot (1 - R_i^2) \cdot \frac{CV(RMSD)_{ini}}{(1 - R_{ini}^2)} \quad (4)$$

In Equation 4, $CV(RMSD)_i$ is the coefficient of variation of the $RMSD$ at each optimization iteration, R_i^2 is the coefficient of determination at each optimization iteration, $CV(RMSD)_{ini}$ is the coefficient of variation of the $RMSD$ of the initial model, and R_{ini}^2 is the coefficient of determination of the initial model. In case of models with multiple thermal zones, the statistics are calculated for each zone and the cost function is calculated based on the averaged statistics.

To efficiently manage the repetitive process of varying the input parameters' values, the calculation of the cost function was tightly integrated with the simulation application. To accomplish this, the monitored indoor air temperatures were incorporated into the model input stream. EnergyPlus runtime language was used to calculate the cost function after each run of the model [22].

3. RESULTS

As shown in Table 3, six variables, which are related to physical properties of the building, were calibrated in the course of the first calibration (first run period). Table 4 includes the respective results. Note that these values were not changed in the course of later calibration runs. However, the infiltration and ventilation rates, as time-varying input parameters, were calibrated in the single-zone model in summer conditions (1st calibration), as well as in the three-zone model in summer and winter conditions (2nd and 3rd calibration). The mean air temperature of the adjacent zones was also calibrated separately for summer and winter conditions (4th and 5th calibration).

The respective calibrated values are summarized in Table 5. Table 6 includes the model evaluation statistics used in the weighted cost function, for the initial and calibrated models during different run periods.

Table 4: The optimized values of physical properties of the model in the first calibration

| Calibration variables | Units | Optimized value |
|-----------------------|------------------------------------|-----------------|
| Solar transmittance | | |
| Green 6mm glass | - | 0.34 |
| Clear 6mm glass | - | 0.54 |
| Thermal conductivity | | |
| Mineral wool | W.m ⁻¹ .k ⁻¹ | 0.031 |
| XPS | W.m ⁻¹ .k ⁻¹ | 0.03 |
| Density | | |
| Ceiling concrete | kg.m ⁻³ | 1260 |
| Wall concrete | kg.m ⁻³ | 980 |

Table 5: The optimized values of time-varying input parameters in performed calibrations

| Calibration variables | Units | Performed calibrations | | | | | |
|-----------------------|-----------------|------------------------|-----------------|-----------------|-----------------|-----------------|------|
| | | 1 st | 2 nd | 3 rd | 4 th | 5 th | |
| Infiltration rate | | | | | | | |
| Summer | h ⁻¹ | 0.40 | 0.12 | - | 0.12 | - | |
| Winter | h ⁻¹ | - | - | 0.28 | - | 0.28 | |
| Ventilation rate | | | | | | | |
| Summer | h ⁻¹ | 0.50 | 0.59 | - | 0.59 | - | |
| Winter | h ⁻¹ | - | - | 0.50 | - | 0.50 | |
| Mean air temperature | | | | | | | |
| Zone 1 | Summer | °C | - | - | - | 28.0 | - |
| | Winter | °C | - | - | - | - | 25.4 |
| Zone 5 | Summer | °C | - | - | - | 26.9 | - |
| | Winter | °C | - | - | - | - | 26.0 |

Table 6: Model evaluation statistics of the initial and calibrated models in different run periods

| Step | Models | 1 st Run period | | 2 nd Run period | | 3 rd Run period | | 4 th Run period | |
|------|-------------------------------|------------------------------|-----------------------|------------------------------|-----------------------|------------------------------|-----------------------|------------------------------|-----------------------|
| | | <i>CV</i> (<i>RMSD</i>) | <i>R</i> ² | <i>CV</i> (<i>RMSD</i>) | <i>R</i> ² | <i>CV</i> (<i>RMSD</i>) | <i>R</i> ² | <i>CV</i> (<i>RMSD</i>) | <i>R</i> ² |
| 1 | Initial 1Z | 4.5% | 0.77 | 4.9% | 0.94 | 15.1% | 0.26 | 16.3% | 0.69 |
| 2 | 1 st calibrated 1Z | 1.4% | 0.88 | 2.2% | 0.96 | 4.4% | 0.35 | 5.5% | 0.81 |
| 3 | Initial 3Z | 7.6% | 0.69 | 7.3% | 0.89 | 19.4% | 0.50 | 13.2% | 0.61 |
| 4 | 2 nd calibrated 3Z | 5.1% | 0.68 | 4.4% | 0.86 | - | - | - | - |
| 5 | 3 rd calibrated 3Z | - | - | - | - | 12.0% | 0.48 | 7.3% | 0.60 |
| 6 | 4 th calibrated 5Z | 3.8% | 0.68 | 3.8% | 0.89 | - | - | - | - |
| 7 | 5 th calibrated 5Z | - | - | - | - | 6.6% | 0.48 | 6.1% | 0.63 |

4. DISSCUSSION

The results suggest that the 1st calibration exercise (single-zone model) significantly improved model predictions (see Table 6, Step 2, 2nd to 4th run periods): *CV(RMSD)* values for the calibrated model are smaller than their non-calibrated counterparts, whereas *R*² values are higher. The initial three-zone model did not perform very well, even though it inherited calibrated variable values derived in the 1st calibration run (see Step 3, Table 6). The reason for this may be the uncertainty regarding the boundary zone assumptions. Internal walls separating zones 1 and 2 as well as zones 4 and 5 were assumed to be adiabatic. Calibration of infiltration and ventilation assumptions did not improve the model's performance in a noteworthy manner (see, Table 6 Step 4 and 5). Only when assumptions regarding indoor temperature of zones 1 and 5 were subjected to calibration, a better model performance could be achieved (Table 6, Step 6 and 7). The performance of optimization-based calibration approach could be improved via more case studies. Moreover, to further rationalize the calibration process, methods like sensitivity analysis could be deployed to identify a subset of the input variables most likely to influence the simulation results.

5. CONCLUDING REMARKS

A case study of an optimization-based calibration method for a thermal performance model of a building was presented. In the course of multiple simulation and calibration steps, ten simulation input variables were subjected to calibration, using monitored data (measured room temperatures). The optimization-based calibration process utilized a cost function that considered both the goodness of fit of the model and error minimization (difference between monitored and simulated values). The results suggest that the predictive performance of simulation models can be noticeably improved, given monitored data to support an optimization-supported simulation model calibration.

Acknowledgements: The research presented in this paper is supported by funds from the project "Control & Automation Management of Buildings & Public Spaces in the 21st Century" (CAMPUS21, project reference: 285729) as well as the "Klima- und Energiefonds" within the program "Neue Energien 2020".

REFERENCES

1. Heo Y, Choudhary R, Augenbroe GA. Calibration of building energy models for retrofit analysis under uncertainty, *Energy and Buildings*, 2012; **47**: 550-60.
2. De Wit S. Uncertainty in Building Simulation, *T & F Group, Advanced Building Simulation*, New York, Spon Press, 2004; 25-60.
3. Mahdavi A, Tahmasebi F. An Optimization-based approach to recurrent calibration of building performance simulation models. *eWork and eBusiness in Architecture, Engineering and Construction, ECPPM2012*, Reykjavik, Iceland, 2012; 145-50.
4. Mahdavi A. Simulation-based control of building systems operation, *Building and Environment*, Band 36, 2001; 789-96.
5. Zach R, et al. MOST: An Open-Source, Vendor and Technology Independent Toolkit for Building Monitoring, Data Processing, and Visualization. [Online], Available at: <http://most.bpi.tuwien.ac.at/download/> [Accessed 30 March 2012].
6. Tahmasebi F, Mahdavi A. Monitoring-based optimization-assisted calibration of the thermal performance model of an office building, *Proceedings of 1st International Conference on Architecture & Urban Design*, EPOKA University, Tirana, Albania, 2012; 1111-16.
7. Peeters L, Wetter M, Ferguson A, D'haesleer W. The coupling of esp-r and genopt: a simple case study, *Proceedings of Fourth National Conference of IBPSA-USA, SimBuild2010*, New York, 2010.
8. Wetter M. *GenOpt, Generic Optimization Program, User Manual Version 2.1.0*, Berkeley: Ernest orlando lawrence berkeley national laboratory, 2008.
9. Wetter M. *GenOpt- A Generic Optimization Program*, Berkeley, USA, U.S. Department of Energy, 2001.
10. Tahmasebi F, Zach R, Schuß M, Mahdavi A. Simulation Model Calibration: An optimization-Based Approach, *Proceedings of Fourth German-Austrian IBPSA Conference, BauSIM2012*, Berlin University of the Arts, Germany, 2012; 386-91.
11. Liu S, Henze GP. Calibration of building models for supervisory control of commercial buildings, *Proceedings of Ninth International IBPSA Conference*, Montreal, Canada, 2005; 641-48.
12. Taheri M, Tahmasebi F, Mahdavi A. A case study of optimization-aided thermal building performance simulation calibration, *Proceedings of BS2013: 13th Conference of International Building Performance Simulation Association*, Chambéry, France, 2013; 603-07.
13. LBNL. *Lawrence Berkeley National Laboratory*, [Online] Available at: <http://simulationresearch.lbl.gov/GO/download.html> [Accessed March 10 2012].
14. *EnergyPlus. Getting Started with EnergyPlus*, Berkeley, USA, The Ernest Orlando Lawrence Berkeley National Laboratory, 2012.

15. Coffey B. A development and testing framework for simulation-based supervisory control with application to optimal zone temperature ramping demand response using a modified genetic algorithm. Montreal, Canada: Concordia University, 2008.
16. MATLAB. [Online] Available at: <http://www.mathworks.com/products/matlab/> [Accessed March 30 2012].
17. Reddy T, Maor IA, Panjapornpon C. *Calibration Detailed Building Energy Simulation Programs with Measured Data- Part I: General Methodology (RP-1051)*, HVAC & R Research, Band 13, 2007; 221-41.
18. Polly B, Kruis N, Roberts D. *Assessing and Improving the Accuracy of Energy Analysis*, US Department of Energy, 2011.
19. Taheri M, Tahmasebi F, Mahdavi A. Two case studies in optimization-based thermal building performance model calibration, *Proceedings of Central European Symposium on Building Physics*, Vienna, Austria, 2013; 559-64.
20. Moriasi DN, et al. *Model Evaluation Guidelines for Systematic Quantification of Accuracy in Watershed Simulations*, American society of agricultural and biological engineers, Band 50, 2007; 885-900.
21. Van Liew MW, Arnold JG, Garbrecht JD. *Hydrologic Simulation on Agricultural Watersheds: Choosing Between Two Models*, Transactions of the ASABE, Band 46, 2003; 1539-51.
22. DOE. *EnergyPlus Application Guide for EMS (a.k.a. The book of Energy Plus Runtime Language)*, US Department of Energy, 2003.